

DESIGN, INSTALLATION
AND MAINTENANCE
MANUAL OF GREENEX
GREENSOL FIXED AEROSOL
FIRE EXTINGUISHING
SYSTEM

P/N GREENSOLMANUAL

APRIL 2019



GREENSOL (POWDERED AEROSOL) Technical Information

TABLE OF CONTENT

Introduction	8
Purpose	
Trade mark and Patent	
1. Use and application	9
2. Safety Summary	10
2.1 General	
2.1.1 Health Effects	
2.2 Hazards to Personnel	
2.2.1 Potential Hazards	
2.2.2 Pre-discharge alarms and time delay	
2.2.3 Egress	
2.2.4 Reduced visibility	
2.2.5 Toxicity	
2.2.6 Thermal Hazards	
2.3 Environmental Factors	
2.4 Compatibility with other agents	
3. Specifications, plans and approvals	13
3.1 Working documents	
3.1.1 Specifications	
3.1.2 Working plans	
3.1.3 Approval of Plans	
3.2 Enclosure	
3.2.1 Loss of Agent	
3.3 Condensed Aerosol System Agent Supply	
3.3.1 Quantity	
3.4 Design application density	
3.4.1 Determining Design Application Density	
3.4.2 Fuel types, table 01 EN-2 / table 01 NFPA	
3.4.3 Standard quantity calculation	
3.4.4 Additional design factors	
3.4.5 Additional quantity calculations for additional design factors	
3.4.5.1 Calculation of leakage rate	
3.4.6 Effects of altitude	
3.4.7 Effects of temperature	



GREENSOL (POWDERED AEROSOL) Technical Information

3.4.8	Effect of ventilation	
3.5	Duration of Protection	
3.5.1	Discharge time	
3.5.2	Extended discharge	
3.5.3	Safety vents	
3.5.4	Generator Choice and location	
3.6	Distribution verification	
4.	General Information	26
4.1	Minimum safe distances	
4.1.2	Minimum safe distances for personnel	
4.1.3	Minimum safe distances for combustibles	
4.2	Safety requirements	
4.3	Electrical clearances	
4.4	Precautions while handling the GreenSol generators	
4.5	Storage and transport	
4.6	Storage conditions	
4.6.1	Environmental operation conditions	
4.7	Replacement & removal from service	
5.	Detection, actuation, alarm and control systems	31
5.1	General	
5.2	Raceways	
5.3	Automatic detection	
5.4	Operating devices	
5.5	Fire alarm control panel	
5.6	Operating alarm and indicators	
5.7	Warning devices	
5.8	Abort switches	
5.9	Alarm indicating failure	
5.10	Warning and instruction signs	
5.11	Pre-discharge alarms and time delays	
5.12	Unwanted system operation	
6.	Components	36
6.1	General	
6.2	GreenEx GreenSol aerosol generator installation procedure	



GREENSOL (POWDERED AEROSOL) Technical Information

7.	System Layout	37
8.	Total flooding system commissioning	38
8.1	Installation acceptance	
8.1.1	Basic checks	
8.1.2	Review enclosure	
8.1.3	Review electrical components	
8.1.3.1	Wiring	
8.1.3.2	Auxiliary Functions	
8.1.3.3	Locations	
8.1.4	Preliminary functional tests	
8.1.4.1	System functional test	
8.1.4.2	Secondary power test	
8.1.4.3	Return of system	
9.	Inspection, Maintenance test, training and safety	42
9.1	Regular inspection	
9.2	Periodic inspection	
9.3	Maintenance	
9.4	Penetrations	
9.5	Condensed aerosol generator inspection	
9.6	Training	
9.7	Safety	
9.8	Residue Removal	
10.	Disposal of discharged aerosol agent	46
10.1	Guidelines to clean the residue	
10.2	Dismantling condensed aerosol generators	
10.3	Waste and environment	
11.	Replacement parts	48
11.1	Label part numbers	
12.	Appendix A; MSDS	49



GREENSOL (POWDERED AEROSOL) Technical Information

13.	Appendix B; Info sheets GreenSol generators	57
13.1	GreenSol A-50	
13.2	GreenSol A-100	
13.3	GreenSol A-200	
13.4	GreenSol A-500	
13.5	GreenSol A-1000	
13.6	GreenSol A-5000	
14.	Appendix C; Fire Classes EN-2	73
15.	Appendix D; Fire Classes NFPA	73
16.	Appendix E; Referenced publications	74
17.	Appendix F; Definitions	75



GREENSOL (POWDERED AEROSOL) Technical Information

Foreword

This manual is written for those who design, install and maintain GreenEx GreenSol aerosol fire suppression systems. This document contains design, installation, operation and maintenance information for this GreenSol fire suppression system.

GreenEx Fire Suppression Solutions accepts no responsibility for applications of any systems other than those addressed in this manual. The technical data in this manual is restricted stringently for information purposes only. GreenEx believes this data to be accurate but it's published and presented without any guarantee or warranty of any kind. GreenEx denies any liability for any use that may be made of the data and information contained herein by any and all other parties.

GreenEx, GreenSol aerosol fire suppression systems are to be designed, installed, inspected, maintained and tested by qualified, trained and certified personnel in accordance with the following:

- **NFPA 2010, and any other applicable NFPA standard**
- **UL-2775**
- **BRL-23001/4**
- **ISO-15779**
- **CEN/TR-15276**
- **NEN EN ISO 9094:2015**
- **All instructions, limitations contained in this manual**
- **Storage, handling and transportation shall be performed by qualified and trained personnel in accordance with local requirements.**

Questions in respect to the information presented in this manual should be addressed to:

GreenEx Fire Suppression Solutions B.V.

www.green-ex.com

support@green-ex.nl

+31 (0) 85 – 04 02 135



GREENSOL (POWDERED AEROSOL) Technical Information

Introduction

GreenEx, GreenSol aerosol fire suppression systems are designed for total flooding applications in accordance with established design criteria. Applications methods, design criteria and restrictions are contained within this manual. In any situation not specified in this manual, the application and the installation of the system must be in accordance with the applicable standard. All installations must meet the requirements of the local authorities.

Purpose

This guide is intended for use by those with the properly mandated authority of purchasing, designing, installing, operating, and maintaining GreenSol aerosol fire extinguishing systems. This guide provides information designed to supplement GreenEx-certified training.

Authorized training is required to design, install, operate and maintain the GreenSol aerosol system! Do not attempt to install or service this system if you have not been provided with authorized training! GreenEx assumes no liability resulting from misuse of the information provided herein.

The requirements of this manual are deemed necessary to provide adequate protection from injury, death, and loss of property from improper installation or fire.

Trademark and Patent

The GreenSol Powdered Aerosol Fire Extinguishing products described in this document are the property of GreenEx Fire Suppression Solutions.

No part of the hardware, software, or documentation may be reproduced, transmitted, transcribed, stored in a retrieval system, or translated into any language or computer language, in any form or by any means, without prior written permission of GreenEx Fire Suppression Solutions BV.

GreenEx Fire Suppression Solutions reserves the right to make changes to any products described herein to improve reliability, function, or design. GreenEx reserves the right to revise this document from time to time in content hereof with no obligation to notify any persons of revisions or changes. GreenEx does not assume any liability arising out of the application or any use of any product or circuit described herein, neither does it convey license under its patent rights or the patent rights of others.



GREENSOL (POWDERED AEROSOL) Technical Information

GreenSol units are not field-repairable. Do not attempt to modify or temper the unit structure as it shall decrease discharge efficiency and lower design application density. Modified units are not subject to repair or exchange under GreenEX product warranty.

GreenSol aerosol fire extinguishing systems for total flooding applications is a registered trademark of GreenEx.

1. Use and Application

GreenSol aerosol suppression systems are effective in extinguishing Class A, B, and C fires. GreenSol aerosol suppression systems provide an efficient and effective means to extinguish gas and liquid fires, burning solid substances, burning substances derived from hydrocarbons (natural gas, oil products, flammable lubricants, etc.), as well as fires in electrical equipment with an operating voltage not exceeding 40,000 Volts.

GreenSol aerosol suppression systems shall not be used on metal fires, on substances generating self-sustaining combustion, and on the following substances unless they have been tested to the satisfaction of the authority having jurisdiction and/or proven by experimental testing carried out by a third party laboratory.

- Deep seated fires in Class A materials
- Class D fires:
 - D1 - light metals (aluminum - Al; magnesium - Mg Titanium ...)
 - D2 - alkali metals (potassium - K; sodium - Na; lithium - Li ...)
 - D3 - organic-metallic compounds (methyl magnesium chloride - CH₃MgCl; methyl magnesium iodide - CH₃MgI; triethyl aluminum - (C₂H₅)₃Al ...)
 - Metal hydrides (aluminum hydride - AlH₃) lithium hydride - LiH ...)
 - Reactive metals such as sodium, potassium, lithium, magnesium, titanium, uranium, and plutonium.
 - Metal powders (magnesium, titanium, etc.)
- Chemical compounds containing oxidizers such as sodium chlorate or sodium nitrate.

The above list may be not exhaustive. Contact GreenEx Fire Suppression Solutions or your local GreenEx distributor if additional information is required.

The GreenSol aerosol generators shall not be employed at less than the minimum safe distances specified in the present guide (see the aerosol generator datasheets for details).

The minimum safe distance between the GreenSol aerosol generator discharge ports and personnel shall be based on an aerosol agent discharge temperature, at that distance, not exceeding 75°C (167°



GREENSOL (POWDERED AEROSOL) Technical Information

F). See Appendix C for generator datasheets and minimum safe distance information.

The minimum safe distance between the GreenSol aerosol generator discharge ports and combustible materials shall be based on an aerosol agent discharge temperature, at that distance, not exceeding 200°C (392° F). *See Appendix C.*

The total flooding GreenSol aerosol suppression system shall be installed in enclosures protecting the hazards that allows the specific agent design application density to be achieved and maintained for the specified period of time.

Where the GreenSol aerosol suppression agents are used in spaces containing sensitive equipment, the potential adverse effects of condensed aerosol particulate residue shall be considered.

2. Safety Summary

For Material Safety Data Sheet refer to Appendix A.

2.1 General

GreenSol aerosol suppression systems can potentially be hazardous to persons due to the mechanism of aerosol dispersal. Unnecessary exposure to the aerosol, byproducts created by the interaction between the aerosol and the fire, and the fire itself should be avoided.

2.1.1 Health Effects

The potential adverse health effects can range from:

- Hazards for humans related to the solid aerosol-forming compound has not been found.
- Hazards to humans related to the aerosol released by the reaction of the solid aerosol-forming compound have not been established because the threshold limit values (TLVs) are not applicable. However, it is reputed that hazards to humans are not present when the aerosol is applied as mandated by this manual.
- Signs and symptoms related to the aerosol release phase are only referred to for acute exposure and/or chronic overexposure. In a real life situation, the exposure to the generated aerosol will only occur accidentally and the exposure time will be very short, as in the event of an accidental or unexpected discharge when an occupant of the protected space has not evacuated previously. The



GREENSOL (POWDERED AEROSOL) Technical Information

aerosol system shall be installed in normally unoccupied spaces and/or in spaces where occupants may be present utilizing suitable safeguards.

2.2 Hazards to Personnel

2.2.1 Potential Hazards

Potential hazards to be considered for individual systems in the protected space and other areas where the aerosol agent can migrate are the following:

Thermal hazard:

The aerosol agent is discharged at temperatures that may be hazardous to personal health. Depending on the needs of the installer, the temperature and minimum clearance from the discharge outlets are specified by the generator data sheets. *After release, the aerosol generators can be hot; protective gloves shall be worn by personnel handling discharged aerosol generators immediately after release.*

Reduced Visibility:

After activation, the aerosol agent reduces visibility during and after the release period.

Turbulence:

Release from discharge outlets is ejected at high speed and may cause enough turbulence inside the protected space to move unsecured objects.

Noise:

The release of a system or aerosol generator may cause considerable noise, but is not detrimental to occupant health.

Eye irritation:

Direct contact with the aerosol particulate being released by the system may result in irritation of the eyes. Exposure of aerosol agent to the eyes should be avoided.



GREENSOL (POWDERED AEROSOL) Technical Information

2.2.2 Pre-Discharge Alarms and Time Delay

Exposure to the aerosol agents shall be prevented by providing a warning of a pending release. A delay prior to the release shall be calibrated to allow occupants to exit the protected space. Predetermined exits shall be provided to assure safe egress of occupants in case of failure of the pre-release alarm and/or time delay.

2.2.3 Egress

Predetermined egress shall be provided to allow the occupants to exit the protected space within the time delay. The effects of reduced visibility during egress shall be considered.

2.2.4 Reduced Visibility

The discharged aerosol will cause occupants to evacuate the protected space under conditions of low visibility. Appropriate safety measures shall be used so that occupants can evacuate safely. The safety measures shall include, but are not limited to: goggles, floor mounted directional lighting, strobes, audio devices, evacuation plans, and exit drills.

2.2.5 Toxicity

See the Material Safety Data Sheet (MSDS) contained in *Appendix A* and the information in section 2.2.1 of this guide.

2.2.6 Thermal Hazards

Aerosol generators shall not be employed at less than the listed minimum safe distance from occupants and combustible materials. See the aerosol generator datasheets for minimum safe distance information. Protective gloves shall be worn by personnel removing discharged aerosol generators.

2.3 Environmental Factors

Though aerosol extinguishing systems do not pose any significant environmental concern, the unnecessary emission of aerosol shall be avoided. All phases of design, installation, testing, and maintenance of aerosol extinguishing systems shall be undertaken with the goal of zero emission to the environment.



GREENSOL (POWDERED AEROSOL) Technical Information

2.4 Compatibility with Other Agents

Unless specifically approved, systems employing the simultaneous release of different agents to protect the same enclosed space shall not be permitted. Where uncorrelated extinguishing or suppression systems are provided, and can operate prior to or during the hold time of the aerosol extinguishing agent, the other agent(s) shall not affect the aerosol's capabilities.

3. Specifications, Plans, and Approvals

3.1 Working Documents

The design of an GreenSol aerosol-flooding suppression system shall be prepared only by a person qualified to design extinguishing systems, in accordance with the advice of the authority having jurisdiction.

Deviation from the working documents shall require the permission and agreement of the authority having jurisdiction.

The working documents shall include, as a minimum requirement, the following:

3.1.1 Specifications

- Designation of the authority having jurisdiction,
- Differences from the standard to be permitted by the authority having jurisdiction,
- Design criteria,
- System sequence of operation,
- Functional testing to be performed after installation of the system,
- System owner/user training requirements.



GREENSOL (POWDERED AEROSOL) Technical Information

3.1.2 Working Plans

- Name of owner and identification of the occupant/user;
- Point of compass and symbol legend.
- Location of building, including address;
- Location and construction characteristics of protected enclosure walls and partitions; location of fire walls.
- Enclosure cross-section, full height or schematic diagram, including raised access floor and suspended ceiling;
- Description of occupancies and hazards to be protected; identification of enclosures normally occupied
- Description of enclosures/facilities/exposures surrounding the enclosure.
- Plan view of protected area showing enclosure partitions (full and partial height); detection, alarm, and control system including all devices and schematic of wiring interconnection; end-of-line device locations; location of controlled devices such as dampers and shutters; location of instructional signage.
- Type of condensed aerosol generators used; including nominal capacity expressed as agent solid compound mass.
- Condensed aerosol design application density.
- Drawings indicating the location and distribution of condensed aerosol generators.
- Equipment list of materials showing device identification, model or part number, quantity and description;
- Description of fire detection, actuation and control systems
- Enclosure pressurization report and venting calculations where applicable;
- Description of wire or cable used including classification, gauge [American Wire Gauge (AWG)], shielding, number of strands in conductor, conductor material, and color coding schedule, with the segregation requirements of various system conductors clearly indicated and the required method of making wire terminations detailed.
- Description of the detector mounting.
- Scale drawing showing the layout of the annunciator panel graphics if required by the authority having jurisdiction.



GREENSOL (POWDERED AEROSOL) Technical Information

- Complete step-by-step description of the system sequence of operations including functioning of abort and maintenance disconnect switches, delay timers, and emergency power shutdown.
- Point-to-point wiring schematic diagrams showing all circuit connections to the system control panel, to the graphic annunciator panel and to external or add-on relays.
- Complete calculations to determine the size of backup batteries and method used to determine number and location of audible and visual indicating devices and number and location of detectors.
- Minimum clearances to combustible materials and the means of egress.
- Details of any special features.

Information shall be submitted for approval to the authority having jurisdiction pertaining to the location and function of:

- Detection devices,
- Operating devices,
- Auxiliary equipment,
- Electrical circuitry, if used.
- All the apparatus and devices used shall be identified.
- Any special features shall be explained.
- The as-built installation drawings and the instruction and maintenance guide that includes a full sequence of operations.
- A full set of drawings and calculations shall be maintained on site.

3.1.3 Approval of Plans

Plans and calculations shall be approved prior to installation.

Where field conditions necessitate any change from approved plans, the change shall be approved prior to implementation.

When such changes from approved plans are made, the working plans shall be updated to accurately represent the system as installed.



GREENSOL (POWDERED AEROSOL) Technical Information

3.2 Enclosure

In the design of an aerosol-flooding extinguishing system, the area of the protected enclosure shall be considered.

Fixed or non-closable openings in the protected enclosure shall be kept to a minimum.

3.2.1 Loss of Agent

To prevent loss of agent through openings to adjacent hazards or work areas, openings shall be permanently sealed or equipped with automatic closures.

Where reasonable confinement of agent is not practicable, protection shall be expanded to include the adjacent connected hazards or work areas or additional agent shall be introduced into the protected enclosure using an extended discharge configuration.

Forced-air ventilating systems shall be shut down or closed automatically where their continued operation would adversely affect the performance of the fire extinguishing system or result in propagation of the fire.

Completely self-contained recirculation ventilation systems shall not be required to be shut down.

The volume of the ventilation system and associated ductwork shall be considered as part of the total hazard volume when determining the quantity of agent.

The protected enclosure shall have the structural strength and integrity necessary to contain the agent discharge.

If the developed pressures present a threat to the structural strength of the enclosure, venting shall be provided to prevent excessive pressures.



GREENSOL (POWDERED AEROSOL) Technical Information

3.3 Condensed Aerosol System Agent Supply

3.3.1 Quantity

Primary condensed aerosol Agent Supply.

The primary aerosol agent supply shall be determined by calculating the required mass of the solid aerosol forming compound needed to meet the design application density.

Reserve condensed aerosol Agent Supply.

Where required, a reserve aerosol agent supply shall consist of as many multiples of the primary agent supply as the authority having jurisdiction considers necessary.

3.4 Design Application Density

3.4.1 Determining Design Application Density

The GreenSol aerosol suppression application density shall be used in determining the minimum design application density for a particular fuel (fire class). For combinations of fuels, the extinguishment value for the fuel requiring the greatest aerosol design application density shall be used, unless specific tests are made on the actual mixture.

Extinguishing application density is calculated by taking the mass of solid aerosol forming compound necessary to extinguish a fire over the volume of the protected space in a test fire.

The design application density is calculated by adding 30 percent to the extinguishing design density. Additional safety factors can be required depending on the specific characteristics of the hazard as specified by this standard. The system designer can then calculate the amount of solid aerosol forming material needed to achieve the design application density and thus protect a given space by applying the formula in 3.4.3.

3.4.2 Fuel Types

Table 01: Fire Classes EN2

Fire class	Burning Materials
A	Solids - surface fires only Ordinary combustible or fibrous material such as wood, paper, fabric, coal, leather, sugar, rubber and some plastics. <i>(not suitable for deep seated fires)</i>
B	Flammable liquids such as petrol, kerosene, alcohol, oil and paint thinners.
C	Flammable gasses such as LPG, butane, acetylene, hydrogen, natural gas and methane.
F	Flammable unsaturated cooking oils in well-insulated cooking appliances, located in commercial kitchens.

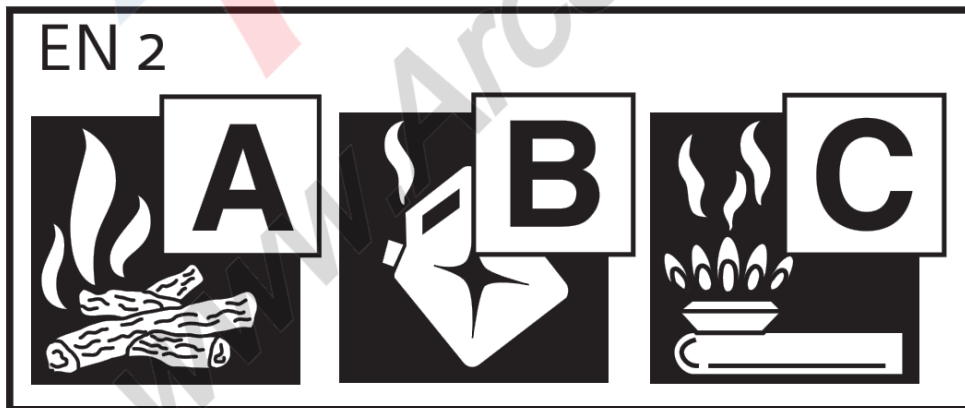


Table 02: Fire Classes NFPA 2010

Fire class	Burning Materials
A	Solids - surface fires only Ordinary combustible or fibrous material such as wood, paper, fabric, coal, leather, sugar, rubber and some plastics. <i>(not suitable for deep seated fires)</i>
B	Flammable liquids and gas such as petrol, kerosene, alcohol, oil and paint thinners.
C	Electrical fires, Electrical hazards. Fires involving live electrical equipment (e.g. computers, switchboards and power tools).





GREENSOL (POWDERED AEROSOL) Technical Information

3.4.3 Standard quantity calculation

The mass of condensed aerosol forming compound required shall be calculated from the following standard formula:

$$M = V \times c \times S$$

where:

m = Total mass of aerosol required to protect the compartment in grams

V = Total volume of the protected enclosure / compartment

c = Application density required to extinguish the fire class in grams per cubic meters.

S = Safety factor of 30% according to NFPA 2010 and international standards.

Fire class	Extinguishing application	Design application including NFPA 30% Safety Factor
Class A fuels solid combustibles:	120 gr./m ³	156 gr./m ³
Class B fuels Flammable liquids:	110 gr./m ³	143 gr./m ³



GREENSOL (POWDERED AEROSOL) Technical Information

3.4.4 Additional Design Factors

For the following (extraordinarily) situations extra correction coefficients(K) must be used to correct to following effects:

- Leakage through enclosure openings
- Effects of ventilation
- Effects of altitude
- Effects of temperature

3.4.5 Additional quantity calculation for additional design factors

$$M = V \times c \times S \times K_1$$

where:

- m = Total mass of aerosol required to protect the compartment in grams
- V = Total volume if the protected enclosure / compartment
- c = Application density required to extinguish the fire class in grams per cubic meters.
- S = Safety factor of 30% according to NFPA 2010 / UL-2775 and international standards.
- K₁ = The ratio based on the calculated leakage rate for the protected volume



GREENSOL (POWDERED AEROSOL) Technical Information

3.4.5.1 Calculation of leakage rate

Leakage rate is calculated according to the following formula:

$$LR = \frac{\sum A_{open}}{A_{total}} \times 100$$

Where:

LR – Leakage rate in % $\sum A_{open}$ (sum of the area of unclosed openings (windows, louvers, doors, etc. in square meters m²))

A_{total} (total surface area of the bounding structure, including floor and ceiling in square meters m²).

For specific project calculation, please contact GreenEx technical support team at support@green-ex.nl or +31 (0) 85 04 02 135.

3.4.6 Effects of altitude

The design calculations of GreenSol aerosol generators should be adjusted to compensate for ambient pressures that vary more than 11 % (equivalent to approximately 1 000 m of elevation change) from standard sea level pressure (1,013 bar absolute). The ambient pressure is affected by changes in altitude, pressurization or depressurization of the protected enclosure, and weather-related barometric pressure changes.

For specific project calculation, please contact GreenEx technical support team at support@green-ex.nl or +31 (0) 85 04 02 135.

3.4.7 Effects of temperature

Temperature, as with altitude, has no effect on condensed aerosol design factor calculations, but it affects the extinguishant spatial distribution. At elevated temperatures aerosol expands to a greater specific volume. A system designed for standard conditions will therefore develop, at the same design factor, a higher distribution at elevated temperatures. Reduction in quantity of extinguishant is, however, not recommended, as it may result in lower extinguishant performance.



GREENSOL (POWDERED AEROSOL) Technical Information

At lower temperatures aerosol may compress to a lesser specific volume. This may result in lower coverage compared to that achieved under standard temperature conditions. The likelihood of this should be low due to a high velocity and the elevated temperature of aerosol being released. At temperatures below -20°C , the quantity indicated at room temperature should be increased to compensate for a lower coverage. Design factor determined at room temperature should be multiplied by a correction coefficient. For information about correction coefficient below zero contact GreenEx technical support team at support@green-ex.nl or +31 (0) 85 04 02 135.

3.4.8 Effects of ventilation

All ventilation systems should be shut down prior to the actuation of GreenSol system. However, the possibility of aerosol discharge into an enclosure that is ventilated should be considered. In such enclosures some extinguishant agent will be lost with the ventilating air.

For information about calculations with ventilation systems contact GreenEx technical support team at support@green-ex.nl or +31 (0) 85 04 02 135.



GREENSOL (POWDERED AEROSOL) Technical Information

3.5 Duration of Protection

The aerosol agent design application density shall be maintained for the specified period of time to prevent re-ignition of the fire before effective emergency action can be taken by trained personnel.

3.5.1 Discharge Time

For the aerosol generator discharge time, see the generator Data Sheets.

3.5.2 Extended Discharge

When an extended discharge is necessary to maintain the design application density for the specified period of time, additional aerosol agent quantities shall be applied.

When an extended discharge is necessary, the rate shall be sufficient to maintain the desired factor for the required hold time. In such applications the aerosol generators may be activated in sequence.

3.5.3 Safety Vents

When aerosol particulate is discharged into a closed volume fully airtight, overpressure may be developed due to the amount of gases generated and the effects of increased temperature of the atmosphere.

Later, the combined volume of aerosol and air will become greater than the initial room volume; the final result will increase the pressure or will exhaust the excess volume through vent openings. The air temperature is increased during the discharge, but will return to normal levels as heat is adsorbed by solid surfaces in the room.

The designer and/or installer shall provide reliable calculations for venting requirements for each system, if applicable, since experience has shown that most ordinary rooms have a sufficient leakage through cracks around doors and windows, and a general porosity that will prevent noticeable pressure build up.

In rooms that may be fully sealed or close to being fully sealed, a safe vent area for low-strength structures can be estimated on the basis of the discharge flow rate. For information about calculations for safety vents / overpressure please contact GreenEx technical support team at support@green-ex.nl or +31 (0) 85 04 02 135.



GREENSOL (POWDERED AEROSOL) Technical Information

3.5.4 Generator Choice and Location

The aerosol generators shall be suitable for the intended purpose and shall be placed within the protected enclosure in compliance with the instruction and limitations contained in this guide with regard to floor coverage, spacing, alignment, and thermal clearances.

The type of aerosol generators selected, their number, and their placement shall be such that the design application density will be established in all parts of the hazard enclosure.

Condensed Aerosol Fire Extinguishing System Arrangement

The condensed aerosol generators and ancillary system components shall be arranged to allow easy inspection and maintenance activities, minimizing the interruption of protection.

Condensed aerosol generators shall not be located where they can be mechanically damaged, exposed to chemicals, or to adverse weather conditions which may render them inoperative.

Suitable protective provisions shall be adopted, if necessary.

Condensed aerosol generators shall be securely installed following the guidance given by this guide.

3.6 Distribution verification

Generator type	Max. area (m ²)	Max. Height (m)	Min. Height (m)	Max. Throw (m)
A-50	.80	1.27	.63	1.45
A-100	1.21	1.51	.80	1.75
A-200	2.01	2.01	1.00	2.30
A-500	3.78	2.91	1.30	3.25
A-1000	5.92	3.59	1.70	4.06
A-5000	14.60	4.97	2.91	5.94

Generator type	Max. area (ft ²)	Max. Height (ft)	Min. Height (ft)	Max. Throw (ft)
A-50	8.61	4.17	2.07	4.76
A-100	13.02	4.95	2.62	5.74
A-200	21.64	6.59	3.28	7.55
A-500	40.69	9.55	4.27	10.66
A-1000	63.72	11.78	5.58	13.32
A-5000	157.15	16.31	9.55	19.48



GREENSOL (POWDERED AEROSOL) Technical Information

4. General Information

4.1 Minimum Safe Distances

Condensed aerosol generators shall not be installed at less than the minimum safe distances as specified in the condensed aerosol generator data sheets. The generator datasheets are in Appendix C of this guide.

The minimum safe distance between the condensed aerosol generator casing and personnel shall be the distance from the generator casing to where the temperature does not exceed 75°C (167°F) during and after discharge.

The minimum safe distance between the condensed aerosol generator casing and combustible materials shall be the distance from the generator casing to where the temperature does not exceed 200°C (392°F) during and after discharge.

4.1.2 Minimum safe distance for Personnel:

Generator type	Discharge stream				Generator casing			
	Distance, in	Distance, cm	Max. temp, °F	Max. temp, °C	Distance, in	Distance, cm	Max. temp, °F	Max. temp, °C
A50	6	15	95	35	.25	0.6	96	35
A100	24	61	142	61	.25	0.6	142	61
A200	36	91	156	69	.25	0.6	166	74
A500	36	91	167	75	.25	0.6	81	27
A1000	36	91	140	60	.25	0.6	146	63
A5000	72	183	166	74	.25	0.6	139	59



GREENSOL (POWDERED AEROSOL) Technical Information

4.1.3 Minimum safe distance for Combustibles

Generator type	Discharge stream				Generator casing			
	Distance, in	Distance, cm	Max. temp, °F	Max. temp, °C	Distance, in	Distance, cm	Max. temp, °F	Max. temp, °C
A50	0	0	290	143	.25	0.6	96	35
A100	0	0	261	127	0	0	310	154
A200	0	0	328	164	0	0	328	164
A500	12	30	318	159	0	0	277	136
A1000	6	15	324	162	0	0	303	151
A5000	24	61	342	156	.25	0.6	151	66

4.2 Safety Requirements

Personnel shall not enter a protected space during or after the agent discharge.

Safeguards shall be provided to ensure prompt evacuation of personnel prior to system discharge, and to prevent entry or re-entry into the protected enclosure after system discharge.

There shall be provided a means for prompt rescue of any trapped personnel, including the following:

- Provision for adequate egress pathways, and procedures to keep them clear at all times
- Provision for emergency lighting and directional signs if necessary to ensure quick, safe evacuation.
- Provision for alarms in such areas that will operate immediately on detection of the fire.
- Provision for only outward-swinging, self-closing doors at exits from hazardous areas and, where such doors are latched, panic hardware shall be installed.
- Provision for continuous alarms at entrances to such areas until the atmosphere has been restored to normal.
- Provision for warning and instruction signs at entrances to and inside such areas. These signs should inform persons in or entering the protected area that an aerosol system is installed and shall contain additional instructions pertinent to the conditions of the hazard.
- Provision for the prompt discovery and rescue of persons rendered unconscious in such areas. This should be accomplished by having such areas searched immediately by trained personnel equipped with



GREENSOL (POWDERED AEROSOL) Technical Information

proper breathing equipment. Self-contained breathing equipment and personnel trained in its use and in rescue practices, including cardiopulmonary resuscitation, should be readily available.

- Provision for instruction and drills for all personnel in or in the vicinity of such areas, including maintenance or construction people, to ensure their correct action when a condensed aerosol system operates.
- Provision for prompt ventilation of such areas, including forced ventilation if necessary. Use caution to avoid spreading condensed aerosol residue to other areas.
- Smoking should be prohibited until the atmosphere has been determined to be free from the condensed aerosol.
- Removal of condensed aerosol generators after discharge shall be done according to the instructions given in this guide. Protective clothing, gloves and goggles should be worn, including a respirator or mask if necessary.
- Any further provision or safeguards shall be adopted if a particular situation indicates it as necessary to prevent injury or death.
- Specific attention shall be given to the possibility that the condensed aerosol may potentially spread to adjacent areas outside of the protected space.

4.3 Electrical Clearances

All system components shall be located to maintain no less than minimum clearances from energized electrical parts as per:

ANSI C2

NFPA 70

29 CFR 1910, Subpart S

Canadian Electrical Code, CSA C22.1

Where the design basic insulation level (BIL) is not available, and where nominal voltage is used for the design criteria, the highest minimum clearance listed for this group shall be used.

The selected clearance to ground shall satisfy the greater of the switching surge or BIL duty, rather than being based on nominal voltage.

The clearance between non insulated, energized parts of the electrical system equipment and any portion of the condensed aerosol extinguishing system shall not be less than the minimum clearance provided elsewhere for electrical system insulations on any individual component.



GREENSOL (POWDERED AEROSOL) Technical Information

4.4 Precautions While Handling the Generator Units

While handling the aerosol generators do not:

- Disassemble the condensed aerosol generators.
- Exert force of impact or carry out other actions to the condensed aerosol generators which may cause distortion and physical or other mechanical damage to the casing.
- Carry out any welding work in the vicinity of the condensed aerosol generators and/or condensed aerosol fire extinguishing system components.
- Smoke in the vicinity of the condensed aerosol generators and/or condensed aerosol fire extinguishing system components.
- Where a condensed aerosol generator, during handling or installation, is dropped or subjected to an impact, ensure that the electric circuit of the ignition and the other condensed aerosol generator components have not been damaged.
- Where a condensed aerosol generator shows external damages to the casing it shall not be installed.

4.5 Storage and Transport

The condensed aerosol generators are classified as Hazard Class or Division 9.

The units shall be transported by ships and by air freight in accordance with regulations and requirements applicable to the above category of cargo.

Transport by road of the aerosol generators is permitted utilizing all types of transport vehicles without any restrictions.

The containers carrying the aerosol generators shall be firmly secured on the vehicle and be protected against dirt, moisture and shock.

Do not drop aerosol generators or the containers carrying them during the vehicles loading/unloading operations.

The aerosol generators shall be stored in their own packaging on racks in warehouses (either heated, or unheated with natural ventilation, at a distance of at least one meter from heating appliances).



GREENSOL (POWDERED AEROSOL) Technical Information

The condensed aerosol generators comply with the requirements of the U.S. Department of Transportation (DOT) and the Canadian Transport Commission, and are classified IAW 49 CFR 172.101, Subpart B or the Canadian equivalent.

ARCO
FIRE
www.Arcofire.com



GREENSOL (POWDERED AEROSOL) Technical Information

4.6 Storage Conditions

Temperature: +5°C to +40°C (+41°F to +104°F)

Humidity: maximum 80% RH

4.6.1. Environmental operation conditions:

Temperature: -40°C to +54°C (-40°F to +130°F)

Humidity: maximum 98% RH

4.7 Replacement & Removal from Service

Service life: 15 years (the year of manufacture appears on each generator)

5. Detection, Actuation, Alarm, and Control Systems

This guide does not address information related to fire detection; however the following general information shall be considered. Always apply national and local code requirements.

5.1 General

Detection, actuation, alarm, and control systems shall be installed, tested, and maintained in accordance with NFPA 70, NFPA 72, NFPA 2010, and local requirements.

In Canada the equipment shall be certified to the requirements of CAN/ULC S524-01 and CAN/ULC-S 529-02.

Automatic detection and automatic actuation shall be used unless a guide-only actuation is approved by the authority having jurisdiction.

5.2 Raceways

System initiating circuits and auxiliary equipment releasing circuits shall be installed in raceways.

National and local requirements shall be observed.

5.3 Automatic Detection



GREENSOL (POWDERED AEROSOL) Technical Information

Automatic detection shall be any listed or standard approved method or device that is capable of detecting and indicating heat, flame, smoke, combustible vapors, or an abnormal condition in the hazard that is likely to produce fire.

Automatic detection shall be any listed or standard approved device compatible with the control panel.

Reliable primary and secondary power sources shall be used, in compliance with national and local requirements, to provide for operation of the detection, signaling, control, and actuation of the system.

5.4 Operating Devices

Operating devices shall include system actuation devices, discharge controls, and shutdown equipment.

Operating devices shall be any listed or standard approved device compatible with the control panel.

The system actuation shall cause simultaneous operation of aerosol generators.

All devices and components shall be designed to be suitable for the specific intended service and working conditions. Devices shall not be susceptible to being rendered inoperative or to accidental operation.

All devices and components shall be installed in appropriate locations or adequately protected to avoid being subject to chemical, mechanical, or any other damages that would render them inoperative.

Manual actuation/release shall be accomplished by an electrical guide release; the arrangement shall include the control equipment monitoring the battery condition, including a low battery signal and alarm.

Manual control(s) for actuation shall be located for easy accessibility at all times, including at the time of a fire.

The manual control(s) shall be of distinct appearance and clearly recognizable for the purpose intended.

Operation of any control station shall cause the complete system to operate.

Manual controls shall not require a pull of more than 178 N (40lb) or a movement of more than 356 mm (14 in.) to secure operation.

At least one manual control station for activation shall be located not more than 1.2 m (4 ft.) above the floor.

All devices for shutting down auxiliary/supplementary equipment shall be considered integral parts of the system and shall function with the system operation.

All the guide operating devices shall be identified as to the hazard they protect.



GREENSOL (POWDERED AEROSOL) Technical Information

5.5 Fire Alarm Control Panel

The fire alarm control panel shall supervise the actuating devices and associated wiring and, as required, cause the system actuation.

The fire alarm control panel shall be any listed or standard approved device, and shall be listed as compatible with the extinguishing system units.

Refer to the Control Panel Guide for compatibility information.

5.6 Operating Alarms and Indicators

Alarms or indicators or both shall be used to indicate the operation of the system, hazards to occupants, or failure of any supervised device.

All alarm or indicator devices shall be any listed or standard approved device, and shall be listed as compatible with the control panel.

The type (audible, visual), number, and location of the devices shall be such that their purpose is satisfactorily accomplished. The extent and type of alarms or indicator equipment or both shall be approved.

5.7 Warning Devices

Audible and visual pre-discharge alarms shall be provided within the protected area to give positive warning of the impending discharge.

The operation of the warning devices shall continue after condensed aerosol discharge, until positive action has been taken to acknowledge the alarm and proceed with appropriate action.

5.8 Abort Switches

Where provided, the system abort switches shall be located within the protected area and shall be located near the means of egress for the area.

All abort switches shall be any listed or standard approved device compatible with the control panel.

An abort switch shall not be operated unless the cause for the condition is known and corrective action can be taken.



GREENSOL (POWDERED AEROSOL) Technical Information

The abort switch shall be of a type that requires constant guide pressure to cause abort.

The abort switch shall not be of a type that would allow the system to be left in an aborted mode without personnel present. In all cases, the guide emergency control shall override the abort function.

Operation of the abort function shall result in both audible and distinct visual indication of system impairment.

The abort switch shall be clearly recognizable.

5.9 Alarms Indicating Failure of Supervised Devices and Equipment

Alarms indicating failure of supervised devices or equipment shall give prompt and positive indication of any failure and shall be distinctive from alarms indicating operation or hazardous conditions.

5.10 Warning and Instruction Signs

Warning and instruction signs at entrances to and inside protected areas shall be provided.

**AUTOMATIC
FIRE-EXTINGUISHING
SYSTEM**

**in case of fire or alarm,
evacuate room immediately**

**AUTOMATIC
FIRE-EXTINGUISHING
SYSTEM**

**in case of fire or alarm,
do not enter**



GREENSOL (POWDERED AEROSOL) Technical Information

5.11 Pre-Discharge Alarms and Time Delays

For the aerosol extinguishing system, a pre-discharge alarm and time delay, sufficient to allow occupant evacuation prior to discharge, shall be provided.

For hazard areas subject to fast-growth fires, where the provision of a time delay would seriously increase the threat to life and property, a time delay shall be permitted to be eliminated.

Time delays shall be used only for occupant evacuation or to prepare the hazard area for discharge.

Time delays shall not be used as a means of confirming operation of a detection device before automatic actuation occurs.

5.12 Unwanted System Operation

Care shall be taken to thoroughly evaluate and correct any factors that could result in unwanted discharges of the system.

To avoid unwanted discharge of an aerosol system during maintenance or when anyone enters the protected enclosure, a supervised disconnect switch shall be provided.

The disconnect switch shall interrupt the releasing circuit to the condensed aerosol system.

The disconnect switch shall be any listed or standard approved device compatible with the control panel.



GREENSOL (POWDERED AEROSOL) Technical Information

6. Components

6.1 General

Do not install GreenSol aerosol generators close to openings.

The recommended optimal distance between the floor of the safeguarded volume and the GreenSol aerosol generator is reported on the GreenSol aerosol generator data sheets.

The discharge outlets of the GreenSol aerosol generators shall not be obstructed.

Minimum safe distances

GreenSol aerosol generators shall not be installed at less than the minimum safe distance as specified in the GreenSol aerosol generator data sheet. *The GreenSol datasheets are in Appendix C of this guide.*

The minimum safe distance between the GreenSol aerosol generator casing and personnel shall be the distance from the generator casing to where the temperature does not exceed 75°C (167°F) during and after discharge.

The minimum safe distance between the GreenSol aerosol generator casing and combustible materials shall be the distance from the generator casing to where the temperature does not exceed 200°C (392°F) during and after discharge.

Listing criteria shall include area coverage, height limits, placement, storage temperature limits, useful lifetime limits, thermal safety parameters, and orientation.

The GreenSol aerosol generators shall be positioned in the protected space/volume so that the aerosol flow does not obstruct or impede the evacuation of personnel.

6.2 GreenEx GreenSol Aerosol Generator Installation Procedure

Warning: *Ensure that the GreenSol aerosol generator is firmly secured!*

The GreenSol aerosol generators are installed utilizing the brackets provided inside the package.

The general installation steps are:

A. Firmly attach the bracket(s) to the enclosure floor, according the system design and the generator location.



GREENSOL (POWDERED AEROSOL) Technical Information

- B. Check the resistance of the electric activation element. This value should be approximately 1.2 to 0.6 ohms.
- C. Connect the aerosol generator to the appropriate fire alarm control panel circuit.
- D. Complete all other connections to the fire alarm control panel. Apply power to the control panel when the installation is complete.

On completion, ensure that the condensed aerosol generators have been installed in the correct manner, i.e. that all requirements contained in this guide have been accomplished. Be sure to record the installation information on the installation certificate or on the technical documentation for the protected premises.

Caution

- Before installing the units, make sure they have not been damaged during shipping.
- Verify the resistance of the igniter (0.8 – 1.4 Ohm and 1.6 – 2.8 Ohm for the A5000 Unit).

7. System Layout

Specifications for GreenSol total flooding aerosol fire suppression systems shall be prepared under the supervision of a person fully experienced and qualified in the design of such systems and with the advice of the authority having jurisdiction.

The specifications shall include all pertinent items necessary for the design of the system, such as the designation of the authority having jurisdiction, variances from the standard to be permitted by the authority having jurisdiction, design criteria, system sequence of operations, the type and extent of the approval testing to be performed after the installation of the system, and owner training requirements.

Disconnect Switch

To comply with NFPA requirements, a manual shut off device / switch should be installed in the circuit. The purpose of this switch is to help prevent accidental activation of the aerosol generators during testing and maintenance of the system.

The manual shut off device / switch shall not be used to abort an activated release countdown sequence!



GREENSOL (POWDERED AEROSOL) Technical Information

Install the manual shut off device / switch as indicated on the plans. A single-gang back box (or similar) shall be used to securely mount the switch. Ensure that all connections are secure and protected. See Figure 12.3.3.

Under normal circumstances the manual shut off device is in the Enable position. When the switch is moved to the Disable position, the control panel will indicate a trouble. As long as the switch remains in the Disable position, the panel is disconnected from the sequential activator modules, preventing the panel from activating the aerosol generators.

System testing and maintenance may be performed while the manual shut off device is in the Disable position.

WARNING: ALWAYS ensure that the panel is in a normal state before returning the manual shut off device back to the Enable position! **Setting the switch to enable while the panel is in a release state will activate the aerosol generators!**

8. Total Flooding System Commissioning

The completed condensed aerosol system shall be reviewed and verified by qualified personnel to meet the approval of the authority having jurisdiction.

All condensed aerosol system components and auxiliary devices used shall be listed or standard approved. Unlisted or unapproved equipment shall not be used under any circumstances.

8.1 Installation Acceptance

8.1.1 Basic Checks

It shall be determined that the protected enclosure is in conformance with the construction documents.

The condensed aerosol generators shall be securely fastened to prevent unacceptable vertical or lateral movement during discharge.

The condensed aerosol generator outputs shall be oriented in such a manner that optimum agent dispersal can be effected.

Aerosol agent shall not directly impinge on areas where personnel could be found or present.

Aerosol agent shall not directly impinge on any loose objects or shelves, cabinet tops, or similar surfaces where loose objects could be present and become missiles.



GREENSOL (POWDERED AEROSOL) Technical Information

An adequate number or quantity of condensed aerosol generators to produce the desired specified design application density shall be provided.

The actual room volumes shall be checked against those indicated on the system drawings to ensure the proper quantity of condensed aerosol agent.

Fan coast down (inertia) and damper closure time shall be taken into consideration.

8.1.2 Review Enclosure Integrity

All total flooding systems shall have the enclosure examined and tested to locate and then effectively seal any air leaks that could result in a failure of the enclosure to hold the specified condensed aerosol design application density for the specified holding period.

8.1.3 Review Electrical Components

8.1.3.1 Wiring

All wiring systems shall be installed in compliance with local codes and the system drawings.

Alternating current (ac) and direct current (dc) wiring shall not be combined in a common conduit or raceway unless shielded and grounded.

All field circuits shall be free of ground faults and short circuits.

Where field circuitry is being measured, all electronic components, such as smoke and flame detectors or special electronic equipment for other detectors or their mounting bases, shall be removed and jumpers shall be installed to prevent the possibility of damage within these devices.

Components shall be replaced after measuring.

Reliable primary and 24-hour minimum standby sources of energy shall be used to provide for operation of the detection, signaling, control, and actuation requirements of the system.



GREENSOL (POWDERED AEROSOL) Technical Information

8.1.3.2 Auxiliary Functions

All auxiliary functions such as alarm-sounding or displaying devices, remote annunciators, air-handling shutdown, and power shutdown shall be checked for operation in accordance with system requirements and design specifications.

If possible, all air-handling and power-cutoff controls shall be of the type that, once interrupted, requires guide restart to restore power.

Silencing of alarms, if desirable, shall not affect other auxiliary functions such as air handling or power cutoff if required in the design specification.

The detection devices shall be checked for proper type and location as specified on the system drawings.

8.1.3.3 Location

Detectors shall not be located near obstructions or air ventilation and cooling equipment that would appreciably affect their response characteristics.

Where applicable, air changes for the protected area shall be taken into consideration.

The detectors shall be installed in a professional manner and in accordance with technical data regarding their installation.

Manual pull stations shall be installed, readily accessible, accurately identified, and protected to prevent damage.

All pull stations used to release agents shall require two separate and distinct actions for operation.

All pull stations used to release condensed aerosol shall be identified.

Particular care shall be taken where manual release devices for more than one system are in close proximity and could be confused or the wrong system actuated.

Pull stations in this instance shall be clearly identified as to which zone or suppression area they affect.

For systems using abort switches, the switches shall be of the dead man type requiring constant manual pressure, installed, readily accessible within the hazard area, and clearly identified.

Switches that remain in the abort position when released shall not be used for this purpose.

The control unit shall be installed and readily accessible.



GREENSOL (POWDERED AEROSOL) Technical Information

8.1.4 Preliminary Functional Tests

At minimum, the following preliminary functional tests shall be performed:

- (1) If the system is connected to an alarm monitoring station, notify them that the fire system test is to be conducted and that an emergency response by the fire department or alarm station personnel is not desired.
- (2) Notify all concerned occupants at the end user's facility that a test is to be conducted and instruct personnel as to the sequence of operation.
- (3) Disable the condensed aerosol system actuation mechanism so that activation of the release circuit will not actuate the generators.
- (4) Check each detector for response.
- (5) Check that polarity has been observed on all polarized alarm devices and auxiliary relays.
- (6) Check that all end-of-line resistors have been installed across the detection and notification appliance circuits where required.
- (7) Check all supervised circuits for trouble response.

8.1.4.1 System Functional Operational Test

The following system functional operational tests shall be performed:

- (1) Operate detection initiating circuit(s).
- (2) Verify that all alarm functions and time delays occur according to design specification.
- (3) Operate the necessary circuit to initiate a second alarm circuit if present.
- (4) Verify that all second alarm functions occur according to design specifications.
- (5) Operate pull release.
- (6) Verify that pull release functions occur according to design specifications.
- (7) Operate abort switch circuit if supplied.
- (8) Verify that abort functions occur according to design specifications.
- (9) Confirm that visual and audible supervisory signals are received by the control panel.

8.1.4.2 Secondary (Standby) Power Test



GREENSOL (POWDERED AEROSOL) Technical Information

The following testing of secondary power shall be performed:

- (1) Disconnect primary power. Confirm the correct trouble indication.
- (2) Operate one of each type of input device. Verify that each event is processed properly.
- (3) Reset the panel after each event.
- (4) Disconnect a device from each circuit and confirm correct trouble indication.
- (5) Reconnect primary power supply. Confirm that the panel returns to normal standby condition.

The control panel shall be readily accessible, yet restricted from unauthorized personnel.

8.1.4.3 Return of System to Operational Condition

When all pre-discharge work is completed, the condensed aerosol generators shall be reconnected so that activation of the release circuit will actuate the condensed aerosol generators, releasing the condensed aerosol agent.

The condensed aerosol system shall be returned to its fully operational design condition.

The central station and all concerned personnel at the end-user's facility shall be notified that the condensed aerosol fire system test is complete and that the system has been returned to full service condition.

9. Inspection, Maintenance Tests, Training, and Safety

9.1 Regular inspection

The customer should perform a monthly check of the total system. These checks should include the following:

- | | |
|-----------------------------------|---|
| The system: | Carry out a visual inspection of the system and verify that it has no damages. |
| The detectors/sensors: | Verify that the fire detectors are in place, are clean, unobstructed and functional. |
| The fire detection system: | Make sure the electrical current identification light functions normally and that all warning lights are off. |



GREENSOL (POWDERED AEROSOL) Technical Information

The GreenEx GreenSol generators: Make sure that the generators are tightly fastened. Make sure the cover of each generator is uncovered and intact.

The installation area: Make sure that no changes have been introduced in the protected space that might hinder the normal function of the system (addition or removal of walls, windows, ventilation shafts, etc.)

9.2 Periodic inspection (every six months)

The entire extinguishing system should undergo a comprehensive inspection every six months.

This inspection should include:

- Check that no changes have been introduced in the protected space, such as: changes in the openings, additional partitions installed, etc.
- Visually inspect the system and check that there are no signs of wear or corrosion, or alterations in the system's installation.
- Check the function of the fire detection system according to manufacturer's specifications.
- Check that the GreenSol powdered aerosol generators are correctly set in place and are not disturbed by any obstacle.

9.3 Maintenance

At least annually, all condensed aerosol release systems shall be subjected to the manufacturer's test and maintenance procedures by competent personnel.

The maintenance report with recommendations shall be filed with the owner.

A periodic inspection of the condensed aerosol generators and aerosol electrical systems shall check the following components:

- Electric wiring
- Terminals of the electrical ignition
- Electric contacts (*clamped fit?*)
- Mounting bolts (*tightened firmly?*)
- The maintenance report with recommendations shall be filed with the owner.
- Replace generators after 15 years



GREENSOL (POWDERED AEROSOL) Technical Information

9.4 Penetrations

Any penetrations made through the enclosure protected by the condensed aerosol system shall be sealed immediately.

The method of sealing shall restore the original fire resistance rating of the enclosure.

9.5 Condensed Aerosol Generator Inspection

Inspections to condensed aerosol generators shall be executed by competent personnel only and the results recorded on both of the following:

- A label permanently attached to each condensed aerosol generator.
- An inspection report
- A completed copy of the inspection report shall be delivered to the owner of the system or to the Authority Having Jurisdiction (or both, as required); the records shall be retained by the owner/user for the life of the condensed aerosol system.
- Where external visual inspection indicates that the condensed aerosol generator casing or the generator itself has been damaged, the unit shall be replaced.

9.6 Training

All persons who could be expected to inspect, test, maintain, or operate the condensed aerosol generator system shall be thoroughly trained and kept thoroughly trained in the functions they are expected to perform.

Personnel working in an enclosure protected by a condensed aerosol fire system shall receive training regarding agent safety issues.

9.7 Safety

Safe procedures shall be observed during installation, servicing, maintenance, testing, and managing of the condensed aerosol generator system.

Always observe all local and national inspection and maintenance requirements.



GREENSOL (POWDERED AEROSOL) Technical Information

9.8 Residue Removal

When activated, the solid aerosol forming compound SFE is transformed into a rapidly expanding aerosol, formed by solid particles suspended in a gas phase. The size of such particles is of a few microns;

The condensed aerosol composition is of Potassium compounds. It is non-corrosive and is not electrically conductive. It does not cause any damage to sensitive protected equipment and does not react on electronic components, metals, etc.

The solid aerosol forming compound SFE does not contain any Halogen compounds that may react with the flame; thus the condensed aerosol does not produce corrosive halogen-acid by products in its reaction with the flames.

The condensed aerosol solid particles suspended into the aerosol phase are in concentration of a few milligrams per cubic meter. These particles are in an anhydrous phase and will settle at the bottom of the protected enclosure after a period of time as a fine dust. This dust can be easily removed by cleaning, before absorbing humidity.

The condensed aerosol by-products after the extinguishing action consists mainly of KOH in very low concentration (transformed rapidly in K_2CO_3) in an anhydrous phase, as the condensed aerosol particles

The following procedures must be followed in the exact sequence to maintain and re-commission a GreenEx GreenSol aerosol generator system:

1. After discharge, allow a minimum holding time of 10 minutes.
2. Do not enter the enclosure, secure enclosure for unauthorized personnel.
3. Switch off electronic apparatus.
4. Keep windows and doors closed.
5. Contact e.g. your local salvage company
6. If the enclosure is safe you may enter the enclosure.
7. Dispose of spent generators according to applicable federal, state, and local regulations.
8. Contact your GreenEx distributor immediately for replacement generators.

GreenEx GreenSol generators has been tested as cold discharge on a wide range of materials including structural, composites and materials commonly used in electronic equipment. In all cases it has been shown that GreenEx GreenSol aerosol generators have no deleterious effect on the operating capability of equipment. For more information, please see SMI test report.



GREENSOL (POWDERED AEROSOL) Technical Information

Due to the ultra-fine particle size and the method of generation, the particulate is quite buoyant and suspends in the gas/air mixture within the protected enclosure. Because of this “buoyant” effect the aerosol does not begin to “settle” for an extended period (up to an hour). Only very minor amounts of particulate may be deposited on equipment. Any particulate deposited on horizontal surfaces will be $\leq 5\mu\text{m}$ and will not form a continuous layer

As a precautionary measure, however, it is always important to inspect and clean the site thoroughly following a cold discharge. While the aerosol itself is quite clean, environmental factors are also a consideration. It is important to decrease the relative humidity below 40% to ensure reduced damage on electronic equipment.

After a fire, the unknown and potentially harmful, by-products of an actual fire pose the biggest risk to sensitive equipment. Because unknown products from the fire itself may be present or because of unwanted environmental conditions, it is always recommended that the area is thoroughly cleaned to insure that no unwanted products are present. During discharge, any dirt within the enclosure will be blown around and then deposited as unwanted residue throughout the area. Also, in rare cases, unit orientation may have been altered improperly or equipment may have been re-oriented within the protected enclosure resulting in an improper discharge directly onto a wall or equipment surface. This could result in the deposit of small, localized areas of highly concentrated agglomerated particulate on that surface. If left untended, an agglomerated mass may take on moisture and may cause non progressive surface discoloration (copper, bronze) of unprotected metal surfaces. It is therefore, very important that any agglomerated particulate be cleaned up by a recognized salvage company.

10 Disposal of Discharged Aerosol Generators and Agent

10.1 Guidelines to Clean the Residue of Condensed Aerosol

- Clean the residues shortly after discharge (within a few hours maximum)
- Wipe off dry residues on floor and metal surfaces using a wet cloth or brush
- Dust away the residues on electrical components using a fan/blower
- Use special sprays suitable to clean the residues that have settled on electronic components
- If the condensed aerosol particles are removed before they can absorb moisture and mix with the combustion residues present in the atmosphere after the fire, they will not react with or affect electronic components, metals, etc.



GREENSOL (POWDERED AEROSOL) Technical Information

- If the condensed aerosol particles (dust) remain for a longer period, they will absorb moisture. The moisture will react with metals (especially uncoated metals), causing oxidation to occur.

10.2 Dismantling Condensed Aerosol Generators

When the condensed aerosol generators have to be dismantled, the following steps shall be accomplished:

- Remove power from the fire detection system and ensure that it cannot be switched on;
- Disconnect the power wires from the condensed aerosol generators and ensure that they cannot be connected;
- Ensure that you are standing firmly and comply with the rules for working at height. (Working Conditions Act);
- Remove the condensed aerosol generators by unscrewing the bolts and nuts holding them;
- Carefully remove the condensed aerosol generator from the brackets and place it on a stable surface;
- After removing the condensed aerosol generators, put the fire detection and alarm installation back into operation in accordance with the guidance of the Authority Having Jurisdiction.
- If the condensed aerosol generators have been activated and are still warm, wear heat-resistant gloves.



GREENSOL (POWDERED AEROSOL) Technical Information

10.3 Waste and Environment

After activation the condensed aerosol generators may be disposed of as normal waste after dismantling.

If a condensed aerosol generator has been removed from service but it has not been activated and it still contains the solid aerosol-forming compound, the generator shall be returned to your local distributor for proper disposal. Whishing wishing well

11. Replacement parts

Item description	Part number
Replacement Igniter A-50	I50GRS
Replacement Igniter A-100	I100GRS
Replacement Igniter A-200	I200GRS
Replacement Igniter A-500	I500GRS
Replacement Igniter A-1000	I1000GRS
Replacement Igniter A-5000	I5000GRS
Mounting bracket A-50	MB50GRS
Mounting bracket A-100	MB100GRS
Mounting bracket A-200	MB200GRS
Mounting bracket A-500	MB500GRS
Mounting bracket A-1000	MB1000GRS
Mounting bracket A-5000	MB5000GRS

11.1 Label part numbers

Item description	Part number
Label GreenSol A50	501050
Label GreenSol A100	502100
Label GreenSol A200	502200
Label GreenSol A500	502500
Label GreenSol A1000	501000
Label GreenSol A5000	505000



GREENSOL (POWDERED AEROSOL) Technical Information

12. Material Safety Data Sheet

1. IDENTIFICATION OF THE SUBSTANCE AND COMPANY

1.1. Identification of the Preparation

Product name: GreenSol
Chemical name: N/A - this is a mixture / preparation
CAS No.: N/A - this is a mixture / preparation
Chemical formula: N/A - this is a mixture / preparation
EINECS No: N/A - this is a mixture / preparation

1.2. Use of the Preparation:

The intended or recommended use of this preparation is as a Fire Extinguishing agent and or Fire Suppression agent.

1.3. Company Identification

Manufacturer / Supplier: GreenEx Fire Suppression Solutions B.V.
Address: P.O. Box 13
7037 ZG Beek
The Netherlands
Phone no.: +31 (0) 85 04 02 135
Email: support@green-ex.nl
Website: www.green-ex.nl
Date of issue: November 2018

1.4. Emergency Telephone

+31 (0) 85 04 02 0135 / +44 (0) 77 21 666 566

2. COMPOSITION / INFORMATION ON INGREDIENTS

2.1.	Ingredient name / Chemical formula	Wt.%	Cas No.	EINECS No.	Class, R and S phrases
	Potassium Nitrate / KNO ₃	75%	7757-79-1	231-818-8	See sec. 15
	Magnesium / Mg	2%	7439-95-4	231-104-6	See sec. 15
	Epoxy Resin Polymer	23%	25068-38-6	See A)	See sec. 15

A) EINECS does not include synthetic polymers (these are registered in EINECS under their building blocks, monomers).
See 67/548/EEC; article 13; 79/831/EC; and 81/437/EC.



GREENSOL (POWDERED AEROSOL) Technical Information

NOTE: Unless a component presents a severe hazard, it does not need to be considered in the MSDS if the concentration is less than 1%.
(According to Directive 1999/45/EC.)

3. HAZARDS IDENTIFICATION

- Hazards for humans related to the SFE compound has not been found.
- Hazards for humans related to the aerosol agent released by the solid SFE compound has not been found, based on the Toxicological assessment.*
- Signs and symptoms related to the aerosol agent are only referred to actual exposure and/or chronic overexposures. In real situations the exposure will be very limited.

3.1. FOR HUMANS

Threshold Limit values: None established

SIGNS AND SYMPTOMS ACUTE EXPOSURE	
Eye Contact	May cause redness
Skin Contact	At normal contact no injury
Inhalation	Can be irritating to mucous membranes.
Ingestion	At normal contact no injury
Chronic overexposure	At normal contact no injury
For Environment	None established

4. FIRST AID MEASURES

- 4.1. First Aid measures are referred to actual exposure and or chronic over exposure

Eye contact: wash eyes with large amounts of water.
Skin contact: Remove clothing and shoes. Wash skin with soap.
Inhalation: Remove from exposure compartment to fresh air.
Ingestion: Not likely



GREENSOL (POWDERED AEROSOL) Technical Information

5. FIRE EXTINGUISHING MEASURES

- 5.1. Extinguishing media: This preparation is an extinguishing agent.
- 5.2. There are NO extinguishing media, which must not be used for safety reasons. If material is involved in a fire, use agent appropriate for material around this product.
- 5.3. Relative to special protective equipment needed for fire fighters. Material will generate an aerosol under conditions of fire,
- 5.4. For personal protection: In places where there is a fire, always wear personal protecting equipment and clothing.

6. ACCIDENTAL RELEASE MEASURES

- 6.1. Personal Precautions
Respiratory protecting: at normal contact not needed
Hand protection: at normal contact not needed
Eye protection: at normal contact not needed
Skin and Body protection: at normal contact not needed
- 6.2. Waste disposal Methods See section 13
- 6.3. Clean up Precautions Sweep up and place in closed container for disposal see section 13.

7. HANDLING AND STORAGE

- 7.1. Handling
Do not mix with other extinguishing agents. Avoid contact with combustible materials. See incompatibility information in Heading 10.
- 7.2. Storage
Should be stored in original container / housing. Keep dry.
- 7.3. Specific use
The intended and or recommended use of this preparation is as a Fire Extinguishing agent.



GREENSOL (POWDERED AEROSOL) Technical Information

8. EXPOSURE CONTROLS AND PERSONAL PROTECTION

- 8.1. Exposure: Before entering a compartment with the material in aerosol phase, mechanical ventilation is preferred to avoid unnecessary exposure.
- 8.2. Personal protection
- | | |
|-------------------------|---|
| Respiratory Protection: | dust mask where dustiness is prevalent, or TLV is exceeded. |
| Hand protection: | at normal contact not needed |
| Eye protection: | goggles recommended as mechanical barrier for prolonged exposure. |
| Skin protection: | at normal contact not needed |

9. PHYSICAL AND CHEMICAL CHARACTERISTICS

- 9.1. General information
- | | |
|-------------|---------------------|
| Appearance: | White to light gray |
| Odor: | None |
- 9.2. Important health, safety and Environmental information
- | | |
|-------------------------------|--|
| pH: | Not applicable. |
| Boiling point/boiling range: | Not applicable. |
| Flash point: | Not applicable. |
| Flammability (solid/gas): | Not flammable. |
| Explosive properties: | Not explosive. |
| Vapor pressure: | Not applicable. |
| Relative density (Water = 1): | Not applicable. |
| Solubility: | -Water solubility: Partially soluble.
-Fat solubility: Not soluble. |
| Viscosity: | Not applicable. |
| Vapor density (Air = 1): | Not applicable. |



GREENSOL (POWDERED AEROSOL) Technical Information

10. STABILITY AND REACTIVITY

- | | | |
|-------|--|---|
| 10.1. | Stability:
Conditions to Avoid: | Stable
On Contact with very hot surfaces
<150° Celsius. |
| 10.2. | Hazardous reactions:
Conditions to Avoid: | Will not occur
None known |
| 10.3. | Materials to Avoid: | None known |
| 10.4. | Hazardous Decomposition Products:
NOT | Hazardous polymerization will
occur. |

11. TOXICOLOGICAL INFORMATION

- 11.1. Product: The toxicity of the product mixture has not been determined.

In case of Fire the Toxicity is caused by the fire itself (fire gasses) and the products involved in the fire.

11.2.	Components		
	Potassium Nitrate	Toxicity:	Oral LD50 (RAT) 3750 mg/kg.
		Target Organs:	Blood, central nervous system
	Magnesium	Toxicity:	Oral LDLO (DOG) 230 mg/kg.
		Target Organs:	Central nervous system, liver and kidneys
	Epoxy Resin Polymer	Irritation Data:	Skin (Guinea Pig) 2750 mg/55 days inert. Eye (Rabbit) 100 mg. Mild.
	Toxicity:	Oral LD50 (RAT) 11.4 g/kg.	



GREENSOL (POWDERED AEROSOL) Technical Information

12. ECOLOGICAL INFORMATION

- 12.1. Mobility: With present data no problems
- 12.2. Degradability: With present data no problems
- 12.3. Bioaccumulation Potential: With present data no problems
- 12.4. Ecotoxicity: With present data no problems
- 12.5. Other Adverse Effects:
- | | |
|---|------|
| Ozon depletion Potential: | None |
| Photochemical Ozone Creation Potential: | None |
| Global Warming Potential: | None |

13. DISPOSAL CONSIDERATIONS

- 13.1. Within the present knowledge of the supplier, this product is not regarded as hazardous waste, as defined by Directive 91/689/EC. Comply with all local, state and federal/international regulations.

14. TRANSPORT INFORMATION

- 14.1. This product is not classified as dangerous according to ADR/RID, IMDG and ICAO/IATA and national regulation as per TNO report 15EM/0337, 06.15367/01.03.

15. REGULATORY INFORMATION

- 15.1. For the components underneath 15.2. the European EU Classification and R&S phrases, referred to the components of the SFE compound are related only to the SINGLE components considered as separated chemical entities. Once mixed in the production of the SFE compound, the risk sentences of the single components are not applicable being the SFE compound a separate chemical entity.



GREENSOL (POWDERED AEROSOL) Technical Information

15.2.	Components			
	Potassium Nitrate	EU Classification R Phrases S Phrases	Oxidizer 8 16 41 36/37/38	- Contact with combustible material may cause fire. Keep away from sources of ignition - NO Smoking. In case of fire and or explosion, do not breathe fumes Irritating to eyes, respiratory system and skin.
	Magnesium	EU Classification R Phrases S Phrases	Flammable 15 17 2 43 7/8	- Contact with water liberates highly flammable gases. Spontaneously flammable in air. Keep out of reach of children. In case of fire never use water. Keep container tightly closed and dry.
Epoxy Resin Polymer	EU Classification R Phrases S Phrases	Irritant 36/38 43 53 28 37/39 61	- Irritating to eyes and skin. May cause sensitization by skin contact. May cause long-term adverse effects in aquatic environment. In case of contact with skin, rinse with water. Wear suitable gloves and eye/face protection. Avoid release to the environment. Refer to special instructions.	

16. OTHER INFORMATION

16.1. Comply with manufacturer's installation and maintenance procedures as mentioned in DESIGN, INSTALLATION AND MAINTENANCE MANUAL OF GREENEX GREENSOL FIXED AEROSOL FIRE EXTINGUISHING SYSTEM. P/N GREENSOL MANUAL.



GREENSOL (POWDERED AEROSOL) Technical Information

17. DISCLAIMER

- 17.1. The above information in the Material Safety Data Sheet reflects the current state of knowledge of our products and shall be used as a guideline. No binding statements as to the contractually agreed product characteristics may be inferred there from. GreenEx Fire Suppression Solutions shall not be held liable for any damage resulting from handling or from contact with the above product.

ARCO
FIRE
www.Arcofire.com



GREENSOL (POWDERED AEROSOL) Technical Information

13. Info sheets GreenEx GreenSol generators

13.1 GreenEx GreenSol A50 Fixed Aerosol Generator



Installation: The GreenEx GreenSol A-50 generator can be installed vertically (cover directed upwards) or horizontally.

The GreenEx GreenSol[®] A50 Fire Extinguisher is based on the environment friendly SFE Powdered Aerosol technology, listed on the USEPA Halon Alternatives SNAP list as Powdered Aerosol A. The A50 model is designed to extinguish and provide extinguishment for Class A (solid fuel), B (liquid and gas fuel), and C (electrical) fires in defined enclosures.

The extinguishing agent concentration required for each type of fire and volume to be protected is determined by the solid SFE agent content in the GreenSol[®] unit and the number of units per system. The extinguishing agent delivered by the GreenSol[®] system is a powdered aerosol created in-situ by a chemical reaction taking place in a non-pressurized container, delivering dry powder small particles (1-5 microns) floating in inert gases.

The GreenEx GreenSol[®] A50 unit produces large amounts of powdered aerosol, designed to extinguish a A-class fire in a 0.32m³ (320 liters) closed volume as designed by the NFPA 2010 standard.

The system is compatible with standard detection and control systems and can be installed inside or outside the protected volume.



GREENSOL (POWDERED AEROSOL) Technical Information

FEATURES & BENEFITS

Powdered Aerosol Halon Replacement
No Ozone Depletion (ODP)
No Global Warming (GWP)
Non-toxic
Highly Efficient - 120 gr/m³
Maintenance Free
Small-Safe-Simple. Piping not required.
For Class A-B-C- Total Flooding Applications
Extremely Cost Effective

APPLICATION EXAMPLES

- CNC - machines and Engine compartments
- Computer Control rooms (sub floor; above ceiling)
- Electrical cabinets and Wind Turbine Nacelles
- Generator & compressor rooms and compartments
- Flammable and combustible liquids and gas storage
- Marine applications
- Paint rooms and battery storage
- Telecommunications facilities
- Military

TECHNICAL SPECIFICATIONS

- **Extinguishing Volume:** 0.5 m³ (100 gr/m³)
- **Activation Mode:** Electrical
- **Powdered Aerosol Color:** white / light gray
- **Discharge Time:** 13 seconds
- **Temperature Range:** -40°C (-40°F) to 54°C (130°F)
- **Toxicity:** None
- **SFE Weight:** 50 gr
- **SFE Specific Gravity:** 1.2 - 1.5 gr/cm³
- **SFE Combustion Velocity:** 1.1 -1.2 mm/sec.
- **Power Supply:** 1.35 A
- **Ignition:** Electrical match (SPEX)
- **Electrical Resistance:** 0.85 - 1.85 Ohm (~ 0.2)
- **Dim:** W 50mm (1.96") H 50mm (1.96") L 97mm (3.81")
- **Total Weight:** 0.6 kg (1.3 lbs.)
- **Ozone Depletion Potential:** None
- **Global Warming Potential:** None

GREENSOL (POWDERED AEROSOL) Technical Information

13.2 GreenEx GreenSol® A100 Fixed Aerosol Generator



Installation: The generator can be installed vertically (cover directed upwards) or horizontally, see picture below. GreenEx GreenSol A-100





GREENSOL (POWDERED AEROSOL) Technical Information

The GreenEx GreenSol® A100 Fire Extinguisher is based on the environment friendly SFE Powdered Aerosol technology, listed on the USEPA Halon Alternatives SNAP list as Powdered Aerosol A. The A100 model is designed to extinguish and provide extinguishment for Class A (solid fuel), B (liquid and gas fuel), and C (electrical) fires in defined enclosures.

The extinguishing agent concentration required for each type of fire and volume to be protected is determined by the solid SFE agent content in the GreenSol® unit and the number of units per system. The extinguishing agent delivered by the GreenSol® system is a powdered aerosol created in-situ by a chemical reaction taking place in a non-pressurized container, delivering dry powder small particles (1-5 microns) floating in inert gases.

The GreenEx GreenSol® A100 unit produces large amounts of powdered aerosol, designed to extinguish a A-class fire in a 0.64 m³ (640 liters) closed volume as designed by the NFPA 2010 standard.

The system is compatible with standard detection and control systems and can be installed inside or outside the protected volume.

FEATURES & BENEFITS

- Powdered Aerosol Halon Replacement
- No Ozone Depletion (ODP)
- No Global Warming (GWP)
- Non-toxic
- Highly Efficient - 120 gr/m³
- Maintenance Free
- Small-Safe-Simple. Piping not required.
- For Class A-B-C Total Flooding Applications
- Extremely Cost Effective

APPLICATION EXAMPLES

- CNC - machines and Engine compartments
- Computer Control rooms (sub floor; above ceiling)
- Electrical cabinets and Wind Turbine Nacelles
- Generator & compressor rooms and compartments
- Flammable and combustible liquids and gas storage
- Marine applications
- Paint rooms and battery storage
- Telecommunications facilities
- Military



GREENSOL (POWDERED AEROSOL) Technical Information

TECHNICAL SPECIFICATIONS

- **Extinguishing Volume:** 1 m³ (100 gr/m³)
- **Activation Mode:** Electrical
- **Powdered Aerosol Color:** white / light gray
- **Discharge Time:** 14 seconds
- **Temperature Range:** -40°C (-40°F) to 54°C (130°F)
- **Toxicity:** None
- **SFE Weight:** 100 gr
- **SFE Specific Gravity:** 1.2 - 1.5 gr/cm³
- **SFE Combustion Velocity:** 1.1 -1.2 mm/sec.
- **Power Supply:** 1.35 A
- **Ignition:** Electrical match (SPEX)
- **Electrical Resistance:** 0.85 - 1.85 Ohm (± 0.2)
- **Dim:** W 60mm (2.36") H 60mm (2.36") L 170mm (6.7")
- **Total Weight:** 1.2 kg / 2.6 lbs.
- **Ozone Depletion Potential:** None
- **Global Warming Potential:** None



GREENSOL (POWDERED AEROSOL) Technical Information

13.3 GreenEx GreenSol® A200 Fixed Aerosol Generator



Installation: The GreenEx GreenSol A-200 generator can be installed vertically (cover directed upwards) or horizontally, see picture below.





GREENSOL (POWDERED AEROSOL) Technical Information

The GreenSol® A200 Fire Extinguisher is based on the environment friendly SFE Powdered Aerosol technology, listed on the USEPA Halon Alternatives SNAP list as Powdered Aerosol A.

The A50 model is designed to extinguish and provide extinguishment for Class A (solid fuel), B (liquid and gas fuel), and C (electrical) fires in defined enclosures.

The extinguishing agent concentration required for each type of fire and volume to be protected is determined by the solid SFE agent content in the GreenSol® unit and the number of units per system. The extinguishing agent delivered by the GreenSol® system is a powdered aerosol created in-situ by a chemical reaction taking place in a non-pressurized container, delivering dry powder small particles (1-5 microns) floating in inert gases.

The GreenSol® A200 unit produces large amounts of powdered aerosol, designed to extinguish a fire in a 1.28 m³ closed volume as designed by the NFPA 2010 standard.

The system is compatible with standard detection and control systems and can be installed inside or outside the protected volume.

FEATURES & BENEFITS

- Powdered Aerosol Halon Replacement
- No Ozone Depletion (ODP)
- No Global Warming (GWP)
- Non-toxic
- Highly Efficient - 120 gr/m³
- Maintenance Free
- Small-Safe-Simple. Piping not required.
- For Class A-B-C Total Flooding Applications
- Extremely Cost Effective

APPLICATION EXAMPLES

- CNC - machines
- Computer Control rooms (sub floor; above ceiling)
- Electrical cabinets
- Generator & compressor rooms and compartments
- Flammable and combustible liquids and gas storage
- Marine applications
- Paint and battery storage
- Engine compartments
- Telecommunications facilities
- Military




GREENSOL (POWDERED AEROSOL) Technical Information

TECHNICAL SPECIFICATIONS


- **Extinguishing Volume:** 2 m³ (100 gr/m³)
- **Activation Mode:** Electrical
- **Powdered Aerosol Color:** white / light gray
- **Discharge Time:** 23 seconds
- **Temperature Range:** -40°C (-40°F) to 54°C (130°F)
- **Toxicity:** None
- **SFE Weight:** 200 gr
- **SFE Specific Gravity:** 1.2 - 1.5 gr/cm³
- **SFE Combustion Velocity:** 1.1 -1.2 mm/sec.
- **Power Supply:** 1.35 A
- **Ignition:** Electrical match (SPEX)
- **Electrical Resistance:** 0.85 - 1.85 Ohm (± 0.2)
- **Dim:** W 80mm (3.15") H 80mm (3.15") L 210mm (8.26")
- **Total Weight:** 2,7 kg / 5.95 lbs.
- **Ozone Depletion Potential:** None
- **Global Warming Potential:** None

GREENSOL (POWDERED AEROSOL) Technical Information

13.4 GreenEx GreenSol® A500 Fixed Aerosol Generator

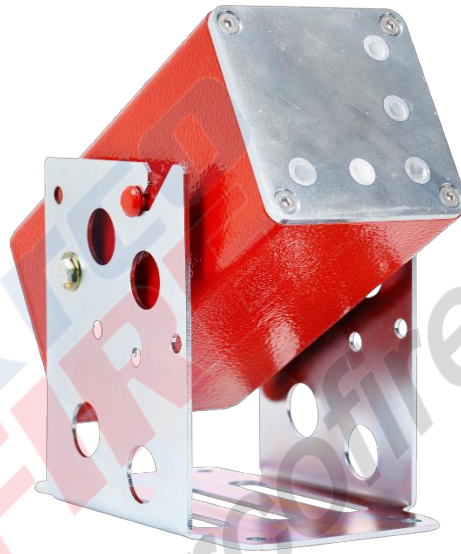

Installation: The GreenEx GreenSol A-500 generator can be installed vertically (cover directed upwards) or horizontally, see picture below.

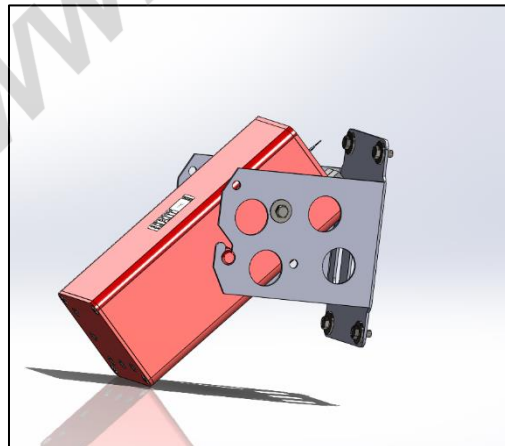



GREENSOL (POWDERED AEROSOL) Technical Information

The GreenEx GreenSol® A500 Fire Extinguisher is based on the environment friendly SFE Powdered Aerosol technology, listed on the USEPA Halon Alternatives SNAP list as Powdered Aerosol A. The A500 model is designed to extinguish and provide extinguishment for Class A (solid fuel), B (liquid and gas fuel), and C (electrical) fires in defined enclosures.

The extinguishing agent concentration required for each type of fire and volume to be protected is determined by the solid SFE agent content in the GreenSol® unit and the number of units per system. The extinguishing agent delivered by the GreenSol® system is a powdered aerosol created in-situ by a chemical reaction taking place in a non-pressurized container, delivering dry powder small particles (1-5 microns) floating in inert gases.

The GreenSol® A500 unit produces large amounts of powdered aerosol, designed to extinguish a fire in a 3.2 m³ closed volume as designed by the NFPA 2010 standard.

The system is compatible with standard detection and control systems and can be installed inside or outside the protected volume.

FEATURES & BENEFITS

- Powdered Aerosol Halon Replacement
- No Ozone Depletion (ODP)
- No Global Warming (GWP)
- Non-toxic
- Highly Efficient - 100 gr/m³
- Maintenance Free
- Small-Safe-Simple. Piping not required.
- For Class A-B-C Total Flooding Applications
- Extremely Cost Effective

APPLICATION EXAMPLES

- CNC - machines and Engine compartments
- Computer Control rooms (sub floor; above ceiling)
- Electrical cabinets and Wind Turbine Nacelles
- Generator & compressor rooms and compartments
- Flammable and combustible liquids and gas storage
- Marine applications
- Paint rooms and battery storage
- Telecommunications facilities
- Military



GREENSOL (POWDERED AEROSOL) Technical Information

TECHNICAL SPECIFICATIONS


- **Extinguishing Volume:** 5 m³ (100 gr/m³)
- **Activation Mode:** Electrical
- **Powdered Aerosol Color:** white / light gray
- **Discharge Time:** 32 seconds
- **Temperature Range:** -40°C (-40°F) to 54°C (130°F)
- **Toxicity:** None
- **SFE Weight:** 500 gr / 17.64oz.
- **SFE Specific Gravity:** 1.2 - 1.5 gr/cm³
- **SFE Combustion Velocity:** 1.1 -1.2 mm/sec.
- **Power Supply:** 1.35 A
- **Ignition:** Electrical match (SPEX)
- **Electrical Resistance:** 0.85 - 1.85 Ohm (± 0.2)
- **Dim:** W 120 mm (4.72") H 120 mm (4.72") L 245 mm (9.64")
- **Total Weight:** 11.6 kg (25.6 pound)
- **Ozone Depletion Potential:** None
- **Global Warming Potential:** None

GREENSOL (POWDERED AEROSOL) Technical Information

13.5 GreenSol® A1000 Fixed Aerosol Generator



Installation: The GreenEx GreenSol A-1000 generator can be installed vertically (cover directed upwards) or horizontally, see picture below.

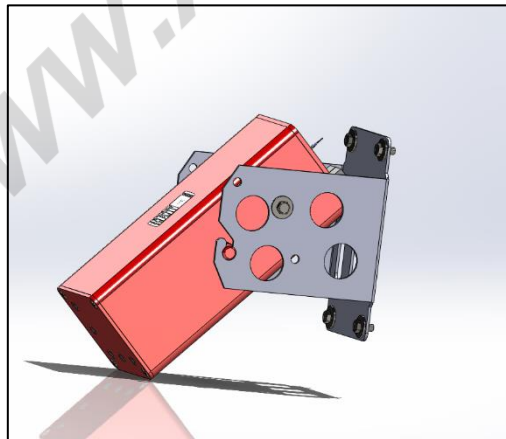



GREENSOL (POWDERED AEROSOL) Technical Information

The GreenEx GreenSol® A1000 Fire Extinguisher is based on the environment friendly SFE Powdered Aerosol technology, listed on the USEPA Halon Alternatives SNAP list as Powdered Aerosol A.

The A1000 model is designed to extinguish and provide extinguishment for Class A (solid fuel), B (liquid and gas fuel), and C (electrical) fires in defined enclosures.

The extinguishing agent concentration required for each type of fire and volume to be protected is determined by the solid SFE agent content in the GreenSol® unit and the number of units per system. The extinguishing agent delivered by the GreenSol® system is a powdered aerosol created in-situ by a chemical reaction taking place in a non-pressurized container, delivering dry powder small particles (1-5 microns) floating in inert gases.

The GreenSol® A1000 unit produces large amounts of powdered aerosol, designed to extinguish a fire in a 6.41 m³ closed volume as designed by the NFPA 2010 standard.

The system is compatible with standard detection and control systems and can be installed inside or outside the protected volume.

FEATURES & BENEFITS

- Powdered Aerosol Halon Replacement
- No Ozone Depletion (ODP)
- No Global Warming (GWP)
- Non-toxic
- Highly Efficient - 120 gr/m³
- Maintenance Free
- Small-Safe-Simple. Piping not required.
- For Class A-B-C Total Flooding Applications
- Extremely Cost Effective

APPLICATION EXAMPLES

- CNC - machines and Engine compartments
- Computer Control rooms (sub floor; above ceiling)
- Electrical cabinets and Wind Turbine Nacelles
- Generator & compressor rooms and compartments
- Flammable and combustible liquids and gas storage
- Marine applications
- Paint rooms and battery storage
- Telecommunications facilities
- Military



GREENSOL (POWDERED AEROSOL) Technical Information

TECHNICAL SPECIFICATIONS

- **Extinguishing Volume:** 10 m³ (100 gr/m³)
- **Activation Mode:** Electrical
- **Powdered Aerosol Color:** white / light gray
- **Discharge Time:** 46 seconds
- **Temperature Range:** -40°C (-40°F) to 54°C (130°F)
- **Toxicity:** None
- **SFE Weight:** 1000 gr
- **SFE Specific Gravity:** 1.2 - 1.5 gr/cm³
- **SFE Combustion Velocity:** 1.1 -1.2 mm/sec.
- **Power Supply:** 1.35 A
- **Ignition:** Electrical match (SPEX)
- **Electrical Resistance:** 0.85 - 1.85 Ohm (± 0.2)
- **Dim:** W 120mm (4.72") H 120mm (4.72") L 320mm (12.59")
- **Total Weight:** 12.5 kg / 27.55 lbs.
- **Ozone Depletion Potential:** None
- **Global Warming Potential:** None



GREENSOL (POWDERED AEROSOL) Technical Information

13.6 GreenEx GreenSol® A5000 Fixed Aerosol Generator



Installation: The GreenEx GreenSol A-5000 generator can be installed vertically (cover directed upwards) or horizontally.

The GreenEx GreenSol® A5000 Fire Extinguisher is based on the environment friendly SFE Powdered Aerosol technology, listed on the USEPA Halon Alternatives SNAP list as Powdered Aerosol A.

The A5000 model is designed to extinguish and provide extinguishment for Class A (solid fuel), B (liquid and gas fuel), and C (electrical) fires in defined enclosures.

The extinguishing agent concentration required for each type of fire and volume to be protected is determined by the solid SFE agent content in the GreenSol® unit and the number of units per system. The extinguishing agent delivered by the GreenSol® system is a powdered aerosol created in-situ by a chemical reaction taking place in a non-pressurized container, delivering dry powder small particles (1-5 microns) floating in inert gases.

The GreenSol® A5000 unit produces large amounts of powdered aerosol, designed to extinguish a fire in a 32 m³ closed volume as designed by the NFPA 2010 standard.

The system is compatible with standard detection and control systems and can be installed inside or outside the protected volume.



GREENSOL (POWDERED AEROSOL) Technical Information

FEATURES & BENEFITS

- Powdered Aerosol Halon Replacement
- No Ozone Depletion (ODP)
- No Global Warming (GWP)
- Non-toxic
- Highly Efficient - 120 gr/m³
- Maintenance Free
- Small-Safe-Simple. Piping not required.
- For Class A-B-C Total Flooding Applications
- Extremely Cost Effective


APPLICATION EXAMPLES

- CNC - machines and Engine compartments
- Computer Control rooms (sub floor; above ceiling)
- Electrical cabinets and Wind Turbine Nacelles
- Generator & compressor rooms and compartments
- Flammable and combustible liquids and gas storage
- Marine applications
- Paint rooms and battery storage
- Telecommunications facilities
- Military

TECHNICAL SPECIFICATIONS

- **Extinguishing Volume:** 50 m³ (100 gr/m³)
- **Activation Mode:** Electrical
- **Powdered Aerosol Color:** white / light gray
- **Discharge Time:** 58 seconds
- **Temperature Range:** -40°C (-40°F) to 54°C (130°F)
- **Toxicity:** None
- **SFE Weight:** 5000 gr / 11.02lbs.
- **SFE Specific Gravity:** 1.2 - 1.5 gr/cm³
- **SFE Combustion Velocity:** 1.1 -1.2 mm/sec.
- **Power Supply:** 1.35 A
- **Ignition:** Electrical match (SPEX)
- **Electrical Resistance:** Linear Connection 1.6 – 2.8 Ohm(± 0.2) / Parallel Connection 0.4 - 1.0 Ohm (± 0.2)
- **Dim:** W 190 mm (7.48") H 445 mm (17.5") L 390 mm (15.34")
- **Total Weight:** 46 kg (101.41 lbs.)
- **Ozone Depletion Potential:** None
- **Global Warming Potential:** None

14. Fire classes by EN-2

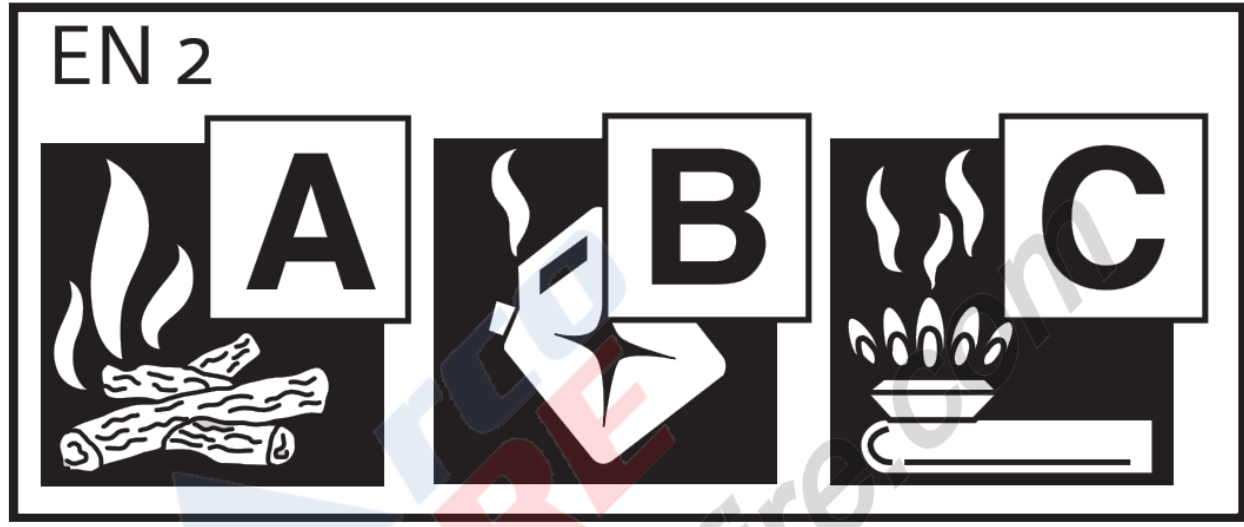

15. Fire Classes by NFPA





GREENSOL (POWDERED AEROSOL) Technical Information

Appendix E – Referenced Publications

UL-2775, April 2014, Fixed Condensed Aerosol Extinguishing System Units

NFPA 2010, Standard for Fixed Aerosol Fire Extinguishing Systems, 2010 Edition for installation. Inspection, testing and maintenance requirements.

NFPA 70 National Electrical Code®, 2005 Edition

NFPA 72 National Fire Alarm Code®, 2010 Edition

NFPA 2001 Standard on Clean Agent Fire Extinguishing Systems

ANSI C2, National Electrical Safety Code, 2001

ISO /IEC Guide 7, Requirements for Standards Suitable for Use for Conformity Assessment, 1994.

IMO MSC/Circ.1270, Guidelines for the Approval of Fixed Aerosol Fire-Extinguishing Systems

Equivalent to Fixed Gas Fire-Extinguishing Systems, as Referred to in SOLAS 74, for Machinery Spaces; 2008 Edition

Title 29, Code of Federal Regulations, Part 1910, Subpart S. Title 46, Code of Federal Regulations, Subchapter C, Parts 24-28.

Title 46, Code of Federal Regulations, Subchapter J, "Electrical Engineering."

Title 49, Code of Federal Regulations, Parts 171-190.

Title 49, Code of Federal Regulations, Part 172.101, Subpart B.

Title 49, Code of Federal Regulations, Part 173.34(e) (01). Title 49, Code of Federal Regulations, Parts 178.36 and 178.37.

Other References

NFPA 10, Standard for Portable Fire Extinguishers, 2002 edition.

NFPA 13, Standard for the Installation of Sprinkler Systems, 2002 edition.

NFPA 51B, Standard for Fire Prevention during Welding, Cutting, and Other Hot Work, 2003 edition.

NFPA 101®, Life Safety Code®, 2006 edition.

NFPA 820, Standard for Fire Protection in Wastewater Treatment and Collection Facilities, 2003 edition.



GREENSOL (POWDERED AEROSOL) Technical Information

Appendix F – Definitions

Except where otherwise noted, the following definitions are taken from NFPA 2010, Standard for Fixed Aerosol Fire-Extinguishing Systems, 2010 Edition.

Actuating mechanism.

A mechanism whose automatic or guide operation leads to the discharge of extinguishing agent.

Agent Quantity.

Mass of solid aerosol-forming compound required to achieve the design application density within the protected volume within the specified discharge time.

Approved.

Acceptable to the authority having jurisdiction.

Authority Having Jurisdiction (AHJ).

An organization, office, or individual responsible for enforcing the requirements of a code or standard, or for approving equipment, materials, an installation, or a procedure.

Automatic.

That which provides a function without the necessity of human intervention. [NFPA 101, 2006]

Automatic/guide switch.

Means of converting the system from automatic to guide actuation.

Classification for Fires

Class A Fire.

Fires in ordinary combustible materials, such as wood, cloth, paper, rubber, and many plastics. [NFPA 10, 2013]

Class B Fire.

Fires in flammable liquids, petroleum greases, tars, oil, oil-based paints, solvents, lacquers, alcohols, and flammable gases. [NFPA 10, 2013]

Class C Fire.

Fires that involve energized electrical equipment. [NFPA 10, 2013]



GREENSOL (POWDERED AEROSOL) Technical Information

Clearance.

Electrical Clearance.

The unobstructed air distance between extinguishing system equipment, including piping and nozzles, and unenclosed or un-insulated live electrical components not at ground potential.

Thermal Clearance.

The air distance between a condensed aerosol generator and any structure or components sensitive to the temperature developed by the generator.

Condensed Aerosol.

An extinguishing medium consisting of finely divided solid particles, generally less than 10 microns in diameter, and gaseous matter, generated by a combustion process of a solid aerosol-forming compound.

Coolant.

A heat-absorbing medium or process.

Design Application Density (g/m^3).

Extinguishing application density, including a safety factor, required for system design purposes.

Discharge Port.

A passage such as nozzles or openings on an aerosol generator where aerosol is released when the generator is actuated.

Disconnect Switch.

A guide operated switch, electrically supervised and secured from unauthorized use, that prevents the automatic or guide electrical activation of the aerosol generators during maintenance by electrically opening the releasing circuit.

Extinguishing Application Density (g/m^3).

Minimum mass of a specific aerosol-forming compound per m^3 of enclosure volume required to extinguish fire involving particular fuel under defined experimental conditions excluding any safety factor.

Generator.

A device for creating a fire-extinguishing medium by pyrotechnical means.

Generator Casing.



GREENSOL (POWDERED AEROSOL) Technical Information

The surface of the generator, excluding the surface containing the discharge ports.

Guide.

Requiring intentional intervention to accomplish a function.

Hold Time.

Period of time during which an extinguishing agent is required to maintain an even distribution throughout the protected volume in an amount at least at the extinguishing application density.

Hot work.

Work involving burning, welding, or similar operation that is capable of initiating fire or explosion. [NFPA 51B, 2003]

Inspection.

A visual examination of a system or portion thereof to verify that it appears to be in operating condition and free of physical damage. [NFPA 820, 2003]

Listed.

Equipment, materials, or services included in a list published by an organization that is acceptable to the authority having jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production of listed equipment or materials or periodic evaluation of services, and whose listing states that either the equipment, material, or service meets appropriate designated standards or has been tested and found suitable for a specified purpose.

Maintenance.

Work performed to ensure that equipment operates as directed by the manufacturer.

Normally Occupied.

An area or space where, under normal circumstances, persons are present.

Normally Unoccupied.

An area or space not normally occupied by people but that can be entered occasionally for brief periods.

Particulate Density.

The density of solid particulate in g/m³ after discharge of the aerosol system at the design application density. This information is used to assess the degrees of visibility obscuration and the potential health effects of accidental exposure to the agent.

Protected Volume.



GREENSOL (POWDERED AEROSOL) Technical Information

Volume enclosed by the building elements around the protected enclosure, minus the volume of any permanent impermeable building elements within the enclosure.

Release

The physical discharge or emission of aerosol as a consequence of the condensed aerosol generator's actuation or operation of the dispersed aerosol agent container.

Shall.

Indicates a mandatory requirement.

Should.

Indicates a recommendation or that which is advised but not required.

Solid Aerosol-Forming Compound.

A solid mixture of oxidant, combustible component and technical admixtures that produces a condensed aerosol upon actuation.

Standard.

A document, the main text of which contains only mandatory provisions using the word "shall" to indicate requirements and which is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Non-mandatory provisions shall be located in an appendix or annex, footnote, or fine-print note and are not to be considered a part of the requirements of a standard.

Supervisory Signal.

A signal indicating the need for action in connection with the supervision of guard tours, the fire suppression systems or the maintenance features of related systems. [NFPA 72, 2002].

Total Flooding Extinguishing System.

A system arranged to discharge an extinguishing agent into an enclosed space to achieve a uniform distribution of that extinguishing agent, at or above the design application density, throughout the space.

Unoccupiable.

An area or space which cannot be occupied due to dimensional or other physical constraints.

The following definitions shall be applicable to marine aerosol extinguishing systems:



GREENSOL (POWDERED AEROSOL) Technical Information

A-60 Class Division.

A bulkhead or deck designed to resist the passage of smoke and flame for 1 hour, including limiting the temperature rise on the unexposed side to 180° C (325° F).

Heat-Sensitive Material.

A material whose melting point is below 1700°F (926.7°C). [NFPA 13, 2002]

Marine System.

An aerosol system installed on a merchant vessel, ship, barge, boat, pleasure craft, offshore platform or other floating structure.

Space.

Cargo Space.

A space for the carriage or storage of items or products that are transported by the vessel.

Machinery Space.

A space protected by an aerosol system containing an internal combustion engine or mechanical equipment for handling, pumping, or transferring flammable or combustible liquids as a fuel to internal combustion engine.

Vessel.

Inspected vessel.

A vessel operated on the navigable waterways of the United States that is subject to the regulations in 46 CFR, which require it to be certificated and inspected as a passenger ship, cargo ship, oceanographic ship or a tank vessel.

Uninspected vessel.

A vessel operated on the navigable waterways of the United States that is subject to the regulations in 46 CFR Subchapter C, Parts 24 - 28, including pleasure craft, tugboats, towing vessels and certain fishing vessels.